




WATERMAIN LAYOUT

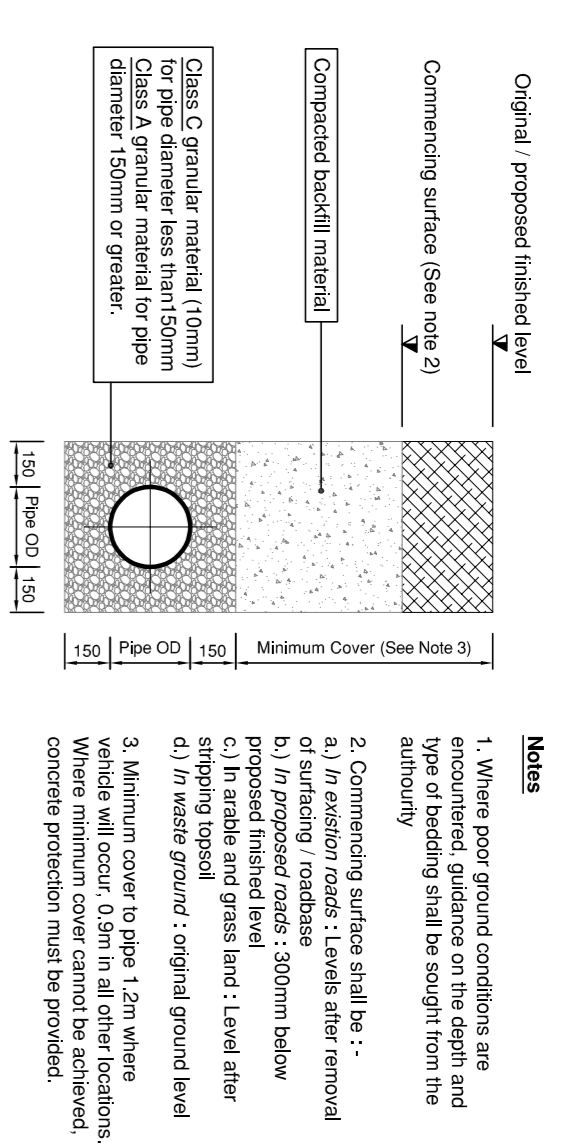

- Notes**
- Where poor ground conditions are identified, the type and depth of bedding shall be sought from the authority.
 - Commencing surface shall be:
 - In wetter areas: 1 level after removal of surfacing / concrete
 - In proposed roads: 300mm below
 - In stable and grass land: 1 level after stripping topsoil
 - In waste ground: original ground level
 - Minimum cover to pipe 1.2m where vehicle will occur; 0.5m in all other locations, where minimum cover shall be provided, consult the authority for details.

- LEGEND**
- 090mm MDPE WATERMAIN
 - 025mm SERVICE TAIL
 - 025mm SERVICE TAIL (IN DUCT)
 - ZV / 9 ZONE VALVE
 - SC STOPCOCK / BOUNDARY BOX

All works to be carried out in accordance with 'Water for Scotland 4th Edition 2019', including design, installation & testing.

DATE	23.06.2021	REVISION	Construction Consent Application	FRN	
DATE		REVISION		DRN	CHK

THIS DRAWING IS COPYRIGHT © . DO NOT SCALE FROM THIS DRAWING.

Arch Henderson
1 9 1 9
Civil Engineers
Structural Engineers
Architects
CDM Co-ordinators
Geotechnical Services
Environmental Services
Engineering Services

Stewart Building, Lenwick, Speldand, ZE1 1LL.
Tel: 01595 695512
www.arch-henderson.co.uk • email: lenwick@arch-henderson.co.uk

Address: Dundee, Glasgow, Lewick, Inverness, Thurso, Stromness, Southampton, Falkland Islands

PROJECT :
Hyalland Housing Association
6no. Housing Development, Marthastoun, Aith

TITLE :
Construction Consent
Watermain

DRAWN:	DATE:	CHECKED:	APPROVED:
AKT	Jan 2021	PNN	PNN

SCALE: (A1)
AS SHOWN

DRAWING NO.: 182143-A-CC-10

REV: -